

# WIZARD 4000-ARC™

## AUTO REFILL CONTROLLER & CHEM-SCALE®

**NET WEIGHT**  
CHEMICAL REMAINING IN TANK

**DAILY USAGE**  
TOTAL CHEMICAL USED PREVIOUS DAY

**AMOUNT USED**  
A RUNNING TOTAL OF CHEMICAL USED


**FEED RATE**  
CURRENT CHEMICAL FEED RATE IN LBS., KGS. OR GALLONS

**DAYS TIL EMPTY**  
DAYS UNTIL EMPTY AT CURRENT FEED RATE

**TARE WEIGHT**  
TANK TARE WEIGHT


**GROSS WEIGHT**  
TANK TARE WEIGHT PLUS CHEMICAL WEIGHT

**PERCENT FULL**  
PERCENT OF TANK FULL

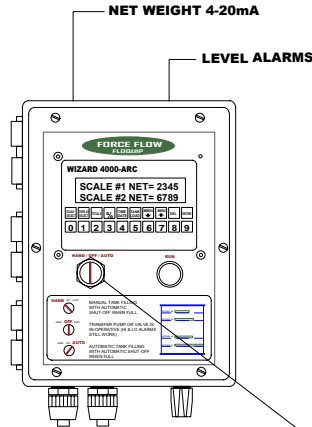


**HAND-OFF-AUTO (HOA) CONTROLS**

- HAND OFF AUTO**  
 MANUAL TANK FILLING WITH AUTOMATIC SHUT-OFF WHEN FULL
- HAND OFF AUTO**  
 TRANSFER PUMP OR VALVE IS IN-OPERATIVE (HI & LO ALARMS STILL WORK)
- HAND OFF AUTO**  
 AUTOMATIC TANK FILLING WITH AUTOMATIC SHUT-OFF WHEN FULL

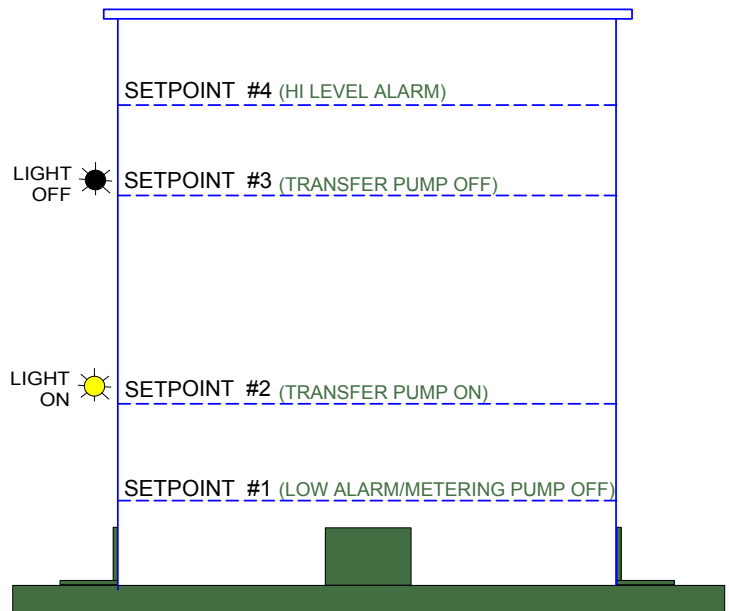

**WIZARD INDICATOR FOR  
TANK REFILL APPLICATIONS**

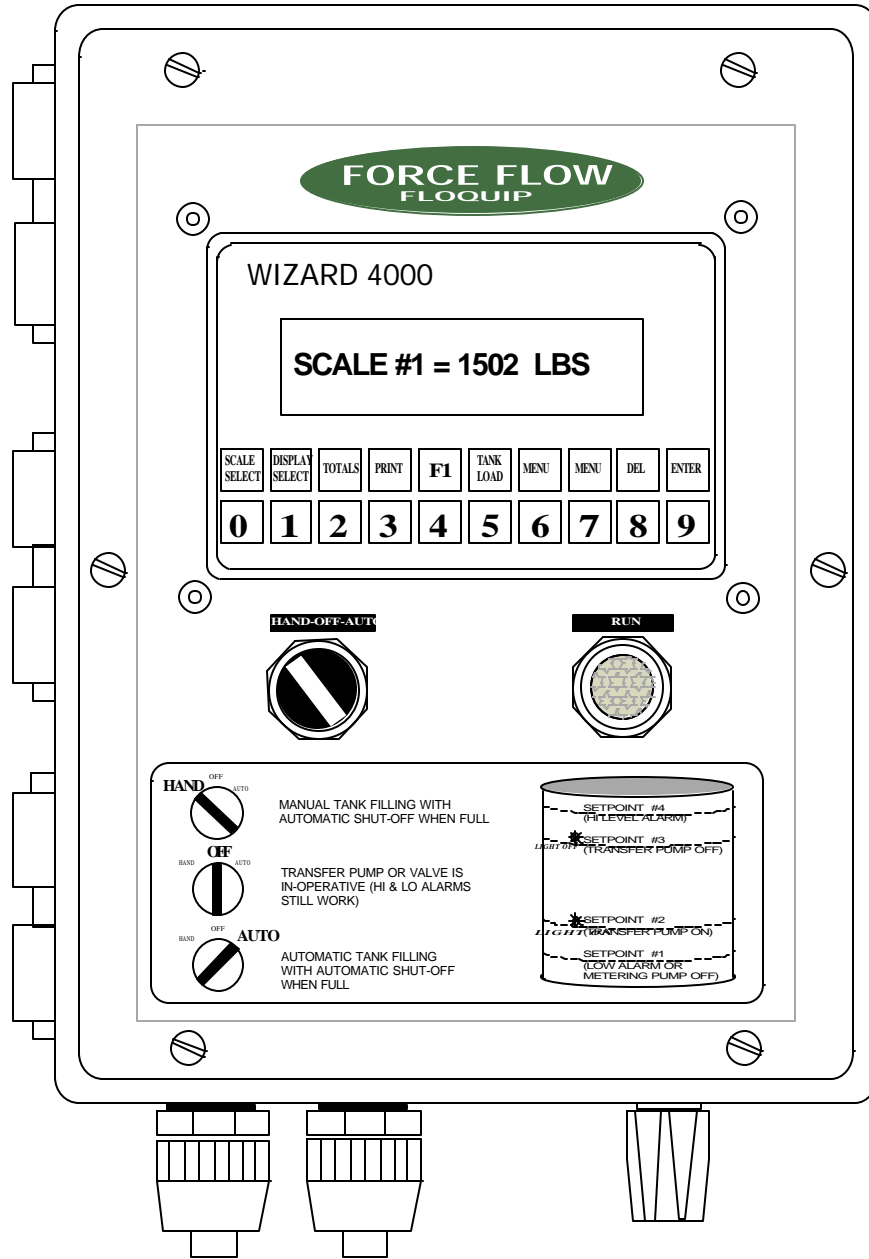

1150-D Burnett Ave, Concord, CA 94520 USA  
1-800-893-6723 US & Canada, Fax: 925-686-6713  
www.forceflow.com / info@forceflow.com

**WIZARD 4000  
AUTO REFILL CONTROLLER**

File: T4IO&MCONTRLRWZAUORE.tow

Drawn by: SLP Drawing Number  
Date: 11/03/97  
Revised: 04/20/98 29991  
Scale: NONE